


# Current sensor, DC out, DR20

DR20-100A-5VDC-60Hz

Serial 941121-1

Data taken on 12/05/94

Ripple=38mV p-p, RL=2.73K

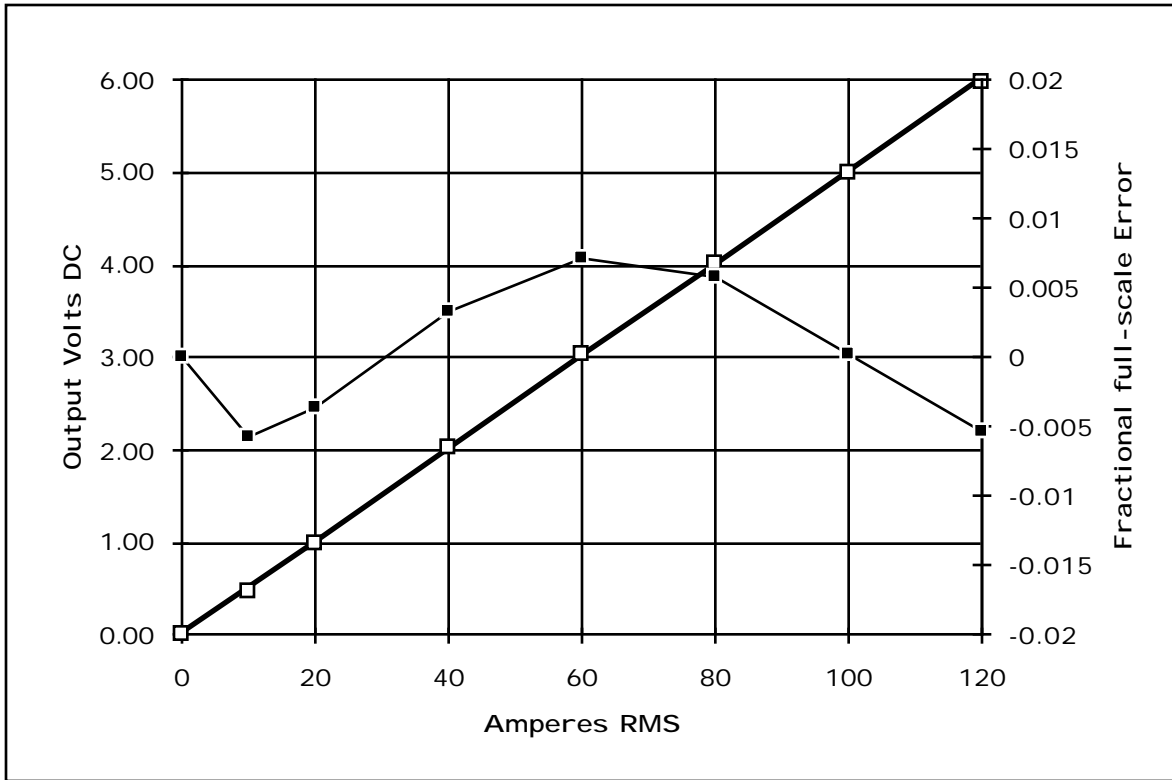

amps	volts	fitted	error
0.00	0.00	0.00	0.00%
9.99	0.47	0.50	-0.57%
20.02	0.98	1.00	-0.36%
40.00	2.02	2.00	0.34%
59.98	3.04	3.00	0.72%
79.95	4.03	4.00	0.58%
100.00	5.00	5.00	0.03%
120.00	5.97	6.00	-0.54%

**Smith Research & Technology, Inc.**



3109 N. Cascade Ave., Bldg. #201  
 Colorado Springs, CO 80907-5190  
 719 634 2259, FAX 719 634 2601